

Product Information

Sensors and Instrumentation

**Flow Transmitter /
 Switch OMNI-FIS**



- Flow measurement in conductive fluids
- A measurement probe for a wide range of piping diameters
- High quality materials
- No moving parts
- Change the sensor without loss of media
- Analog output 4..20 mA or 0..10 V
- Two programmable switches
- Graphical LCD display, backlit, can be read in sunlight and in the dark
- Selectable units in the display
- Programmable parameters via rotatable, removable ring (programming protection)
- Electronics housing with non-scratch, chemically resistant glass
- Rotatable electronic housing for best reading position
- Designed for industrial use
- Small, compact construction
- Simple installation

Characteristics

The FIS magnetic-inductive flow probes are built into the piping by means of the supplied welded-on sleeves (DN 50..DN 400) or by means of the plastic fixing clip (DN 50..DN 150) .

The complete measurement probe is removable without creating an opening to the medium, and so if a fault occurs, only the electronic part is replaced.

When an electric conductor moves at right angles to the magnetic field, the movement induces a voltage U in the conductor. With this measurement principle, the electrically conductive medium is the conductor. The magnetic field B is transverse to the direction of flow. The induced voltage U is directly proportional to the local flow speed v.

The OMNI transducer located on the sensor has a backlit graphics LCD display which is very easy to read, both in the dark and in bright sunlight. The graphics display allows the presentation of measured values and parameters in a clearly understandable form. The measured values are displayed to 4 places, together with their physical unit, which may also be modified by the user. The electronics have an analog output (4..20 mA or 0..10 V) and two switching outputs, which can be used as limit switches for monitoring minimal or maximal, or as two-point controllers. The switching outputs are designed as push-pull drivers, and can therefore be used both as PNP and NPN outputs. Exceeding limit values is signalled by a red LED which is visible over a long distance, and by a cleartext in the display. The stainless steel case has a hardened non-scratch mineral glass

pane. It is operated by a programming ring fitted with a magnet, so there is no need to open the operating controls housing, and its leakproofness is permanently ensured.

By turning the ring to right or left, it is simple to modify the parameters (e.g. switching point, hysteresis...). To protect from unintended programming, it can be removed, turned through 180 ° and replaced, or completely removed, thus acting as a key.



OPTION C:

Preset Counter with external reset option, complementary switching outputs and actual value display.

OPTION C1:

Instantaneous value display with analogue output, pulse-volume output and totalizer


Technical data

| | | |
|-------------------------------------|---|---|
| Sensor | magnetic-inductive | |
| Nominal width | DN 50..300 welded-on nozzle DN 50..150 tapping sleeve | |
| Process connection | welded-on nozzle, tapping sleeve | |
| Metering ranges | full scales 1..8 m/s in steps of 1 m/s | |
| Measurement accuracy | ±5 % of the measured value, (when calibrated on the spot ±2 % of the measured value), from 3 cm/s | |
| Repeatability | ±2 % of the measured value | |
| Time constant | 5 seconds fixed | |
| Media | conductive, largely homogeneous fluids, pastes, and slurries, also having solids components | |
| Electrical conductivity | min. 20 mS/cm | |
| Medium temperature | -25..+150 °C | |
| Ambient temperature | -25..+60 °C | |
| Pressure resistance | max. 25 bar, welded-on nozzle max. 10 bar, tapping sleeve | |
| Materials | Probe | stainless steel 1.4435 |
| | Insulation | ceramic (zirconium oxide) |
| | Tapping sleeve | PP, 1.4305 |
| | Electronics housing | stainless steel 1.4305 FKM and Klingerit |
| Materials non-medium-contact | Electronics housing | stainless steel 1.4305 |
| | Glass | mineral glass hardened |
| | Magnet | samarium-Cobalt |
| | Ring | POM |
| Supply voltage | 18..30 V DC | |
| Power consumption | < 2 W | |
| Analog output | 4..20 mA / max. load 500 Ω or 0..10 V / min. load 1 kΩ | |


Product Information

| | |
|------------------------------|---|
| Switching outputs | transistor output "push-pull" (resistant to short circuits and polarity reversal) $I_{out} = 100 \text{ mA max.}$ |
| Hysteresis | adjustable, position of the hysteresis depends on minimum or maximum |
| Display | backlit graphical LCD-Display (transreflective), extended temperature range $-20..+70 \text{ }^\circ\text{C}$, 32×16 pixels, background illumination, displays value and unit, flashing LED signal lamp with simultaneous message on the display. |
| Electrical connection | for round plug connector M12x1, 5-pole |
| Ingress protection | IP 67 |
| Weight | see table "Dimensions" |
| Conformity | CE |


Wiring

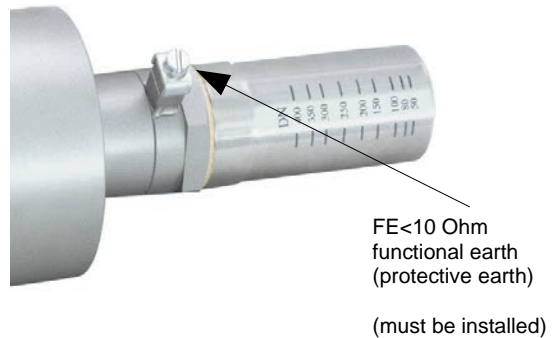

Signal output curves

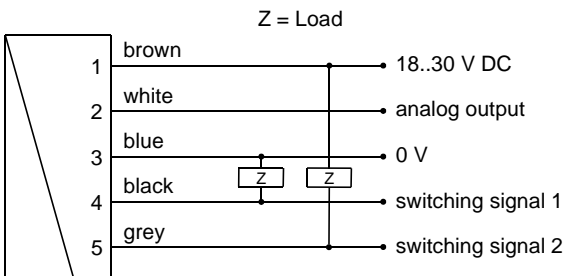

Connection example: PNP NPN




connector M12x1


See separate wiring at C and C1 option in the separate descriptions.

Value x = Begin of the specified range
 = not specified range


Current output




Voltage output



Other characters on request.

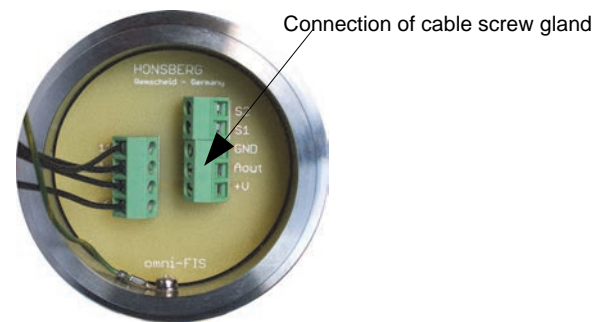


Dimensions

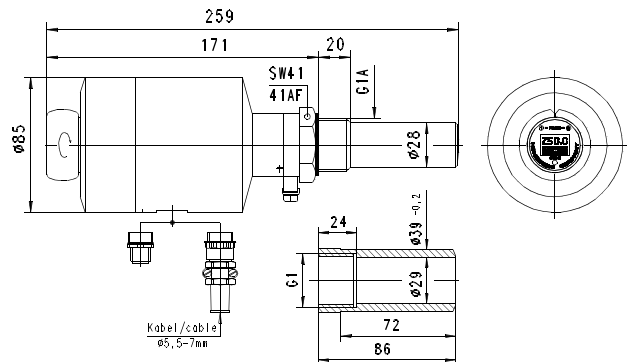


Product Information

Sensors and Instrumentation

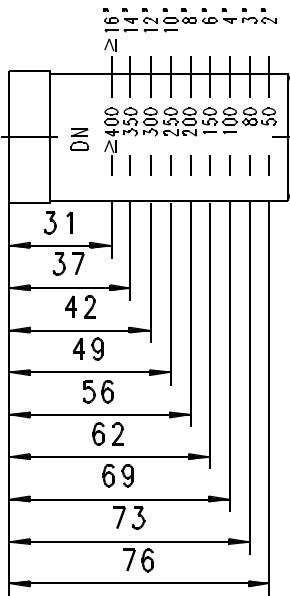

do with the alignment of the housing. This is possible at any time, without affecting the alignment of the internal component. The metering range full scale value has already been set in the factory to the desired metering range, by means of the DIP switches (1, 2, 3, 4, 5, 6, 7, 8 m/s, see drawing). The figures next to the DIP switches are valid.

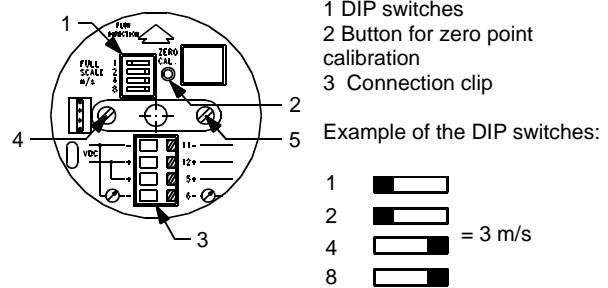


Zero point setting:

- Fill the piping completely with medium
- Flow speed in the piping must be "zero"
- Press the "ZERO CAL" button
- After one minute, the device has automatically self-calibrated

Handling and operation

Installation

The FIS magnetic-inductive probes are installed in the pipework by means of the supplied welded-on sleeves or by means of the plastic fixing clip (\geq DN 50 / \geq G 2). See diagrams for installation position and depth.

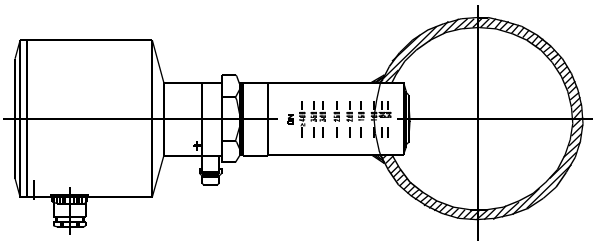

Weld on the nozzle at the marking according to its nominal width, free of distortion.

Run-in and run-out sections must be greater than or equal to 10 x pipework diameter. Weld on the connection sleeve at right angles to pipework mid-line (see marking = external pipework diameter, for >DN 400 also at 400). Avoid distortions. The probe must screw in easily. After screwing in, the probe can be adjusted by rotating it.

The complete measurement probe is removable without creating an opening to the medium, and so if a fault occurs, only the electronic part is replaced.

The electrical connection is made after opening the cover (unlosable because of its earthing cable). For this, completely remove the three internal hex bolts from the lid.

The arrow on the electronics insert must be in the direction of flow (loosen bolts 4 and 5 by approx. 2 or 3 turns. Do not remove completely) Turn the electronic component appropriately, and then tighten the bolts again. The alignment of the arrow has nothing to

Programming

The annular gap of the programming ring can be turned to positions 1 and 2. The following actions are possible:



Set to 1 = continue (STEP)
 Set to 2 = modify (PROG)

Neutral position between 1 and 2

The ring can be removed to act as a key, or turned through 180° and replaced to create a programming protector. Operation is by dialog with the display messages, which makes its use very simple.

Starting from the normal display (present value and unit), if 1 (STEP) is repeatedly selected, then the display shows the following information in this order:

Display of the parameters, using position 1

- Switching value S1 (switching point 1 in the selected unit)
- Switching characteristic of S1
 MIN = Monitoring of minimum value
 MAX = Monitoring of maximum value
- Hysteresis 1 (hysteresis value of S1 in the set unit)
- Switching value S2
- Switching characteristic of S2
- Hysteresis 2
- Code
 After entering the **code 111**, further parameters can be defined:
- Filter (settling time of the display and output)
- Physical unit (Units)
- Output: 0..20 mA or 4..20 mA
- 0/4 mA (measured value corresponding to 0/4 mA)
- 20 mA (measured value corresponding to 20 mA)

For models with a voltage output, replace 20 mA accordingly with 10 V.

Product Information

Sensors and Instrumentation


Edit, using position 2

If the currently visible parameter is to be modified:


- Turn the annular gap to position 2, so that a flashing cursor appears which displays the position which can be modified.
- By repeatedly turning to position 2, values are increased; by turning to position 1, the cursor moves to the next digit
- Leave the parameter by turning to position 1 (until the cursor leaves the row); this accepts the modification.
- If there is no action within 30 seconds, the device returns to the normal display range without accepting the modification.

The limit switches S1 and S2 can be used to monitor minimal or maximal.

With a minimum-switch, falling below the limit value causes a switchover to the alarm state. Return to the normal state occurs when the limit value plus the set hysteresis is once more exceeded.

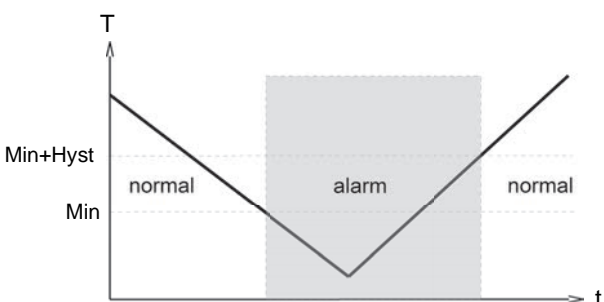

With a maximum-switch, exceeding the limit value causes a switchover to the alarm state. Return to the normal state occurs when the measured value once more falls below the limit value minus the set hysteresis.

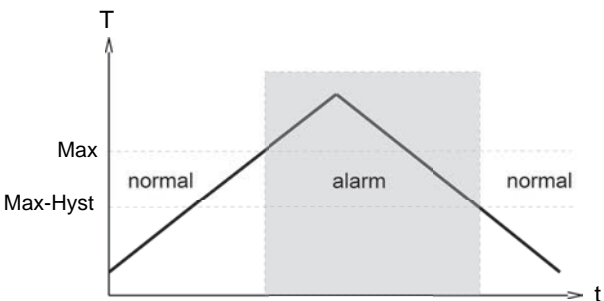

The change to the alarm state is indicated by the integrated red LED and a cleartext in the display. While in the normal state the switching outputs are at the level of the supply voltage; in the alarm state they are at 0 V, so that a wire break would also display as an alarm state at the signal receiver.

Overload display

Overload of a switching output is detected and indicated on the display ("Check S1 / S2"), and the switching output is switched off.

Simulation mode

To simplify commissioning, the sensor provides a simulation mode for the analog output. It is possible to create a programmable value in the range 0..26.0 mA at the output (without modifying the process variable). This allows the wiring run between the sensor and the downstream electronics to be tested during commissioning. This mode is accessed by means of **Code 311**.

Factory settings

After modifying the configuration parameters, it is possible to reset them to the factory settings at any time using **Code 989**.

Ordering code

The basic device is ordered e.g. FIS xxx with electronics e.g. OMNI-FIS xxxx

FIS 1. 2. 3. 4. 5. E

OMNI- FIS- 6. 7. 8. 9.

○=Option

| 1. Nominal width | | | | | | | | | | |
|---------------------------------------|---|--|--|--|--|--|--|--|--|-----------|
| 025 | DN 25 (welded-on nozzle) for installation from DN50 | | | | | | | | | |
| 050 | DN 50 (tapping sleeve) | | | | | | | | | |
| 065 | DN 65 (tapping sleeve) | | | | | | | | | |
| 080 | DN 80 (tapping sleeve) | | | | | | | | | |
| 100 | DN 100 (tapping sleeve) | | | | | | | | | |
| 125 | DN 125 (tapping sleeve) | | | | | | | | | |
| 150 | DN 150 (tapping sleeve) | | | | | | | | | |
| 2. Mechanical connection | | | | | | | | | | |
| V | welded-on nozzle | | | | | | | | | • |
| B | tapping sleeve | | | | | | | | | • • • • • |
| 3. Material for mechanical connection | | | | | | | | | | |
| K | stainless steel (welded-on nozzle) | | | | | | | | | • |
| B | PP (tapping sleeve) | | | | | | | | | • • • • • |
| 4. Full scale value of range | | | | | | | | | | |
| 001 | 1 m/s | | | | | | | | | |
| 002 | 2 m/s | | | | | | | | | |
| 003 | 3 m/s | | | | | | | | | |
| 004 | 4 m/s | | | | | | | | | |
| 005 | 5 m/s | | | | | | | | | |
| 006 | 6 m/s | | | | | | | | | |
| 007 | 7 m/s | | | | | | | | | |
| 008 | 8 m/s | | | | | | | | | |
| 5. Connection for | | | | | | | | | | |
| E | electronics | | | | | | | | | |
| 6. For nominal width | | | | | | | | | | |
| 025 | DN 25 (welded-on nozzle) | | | | | | | | | • |
| 050 | DN 50 (tapping sleeve) | | | | | | | | | • |
| 065 | DN 65 (tapping sleeve) | | | | | | | | | • |
| 080 | DN 80 (tapping sleeve) | | | | | | | | | • |
| 100 | DN 100 (tapping sleeve) | | | | | | | | | • |
| 125 | DN 125 (tapping sleeve) | | | | | | | | | • |
| 150 | DN 150 (tapping sleeve) | | | | | | | | | • |
| 7. Analog output | | | | | | | | | | |
| I | current output 0/4..20 mA | | | | | | | | | • |
| U | ○ voltage output 0/2..10 V | | | | | | | | | • |
| K | without | | | | | | | | | • |
| 8. Electrical connection | | | | | | | | | | |
| G | cable screw gland Pg 9 excluding cable | | | | | | | | | |
| S | ○ for round plug connector M12x1, 5-pole | | | | | | | | | |
| 9. Option 2 | | | | | | | | | | |
| C | ○ Counter C | | | | | | | | | |
| C1 | ○ Counter C1 | | | | | | | | | |

Options

Counter C (hardware and software option):
Preset Counter with external reset option, complementary switching
outputs and actual value display
(modified wiring diagram!)

Counter C1 (software option):
Instantaneous value display with analogue output, pulse-volume
output and totalizer

Accessories

- Cable/round plug connector (KB...)
see additional information "Accessories"
- Device configurator ECI-1